


PLAN VIEW


GENERAL NOTES:

1. PRECAST CONCRETE TO MEET THE REQUIREMENTS OF ODOT 706.13 AND BE MARKED WITH STATION NUMBER AS APPLICABLE.
2. PRECAST WALLS TO HAVE A MINIMUM THICKNESS OF 6" AND BE REINFORCED SUFFICIENTLY TO PERMIT SHIPPING AND HANDLING.
3. OPENINGS FOR PIPE WILL BE PIPE O.D. + 2" UNLESS SPECIFIED OTHERWISE.
4. PRECAST TOPS AND/OR CAST IRON FRAMES, GRATES, AND COVERS AVAILABLE PER PROJECT SPECIFICATIONS.
5. ENTRAINED AIR CONTENT = 6% ± 2%.
6. CONCRETE: 5,000 PSI @ 28 DAYS.

ODOT	A (IN.)	B (IN.)
#6	18	36
CC	24	36
3A	26	27
#3	27	57
#5	32	32
#8	32	32
#4	36	64
I3A	36	58
I3B	36	64
I3C	20	36
I3D	26	36
I2	24	32
I2A	24	32
2-2A	24	24
2-2B	24	24
2-3	36	36
2-4	48	48
2-5	60	60
2-6	72	72

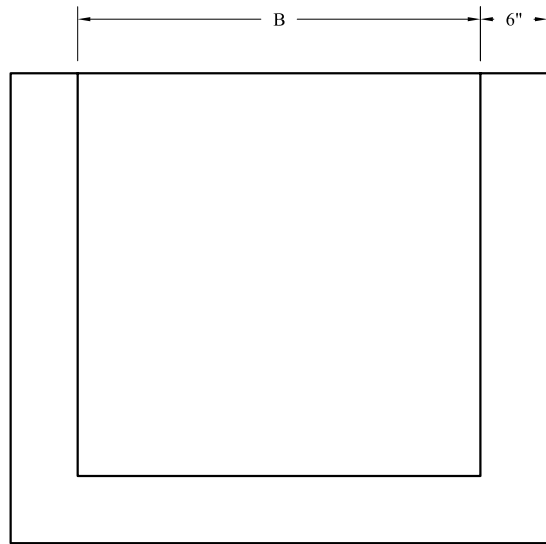

SECTION X-X

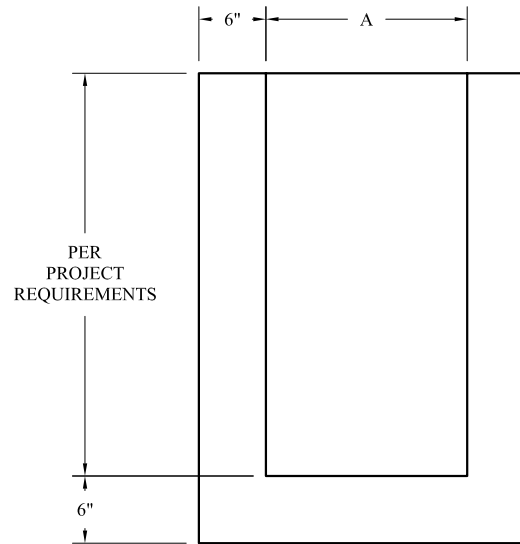

SECTION Y-Y

NCI
 Norwalk Concrete Industries
 80 Commerce Drive
 Norwalk, Ohio 44857
 www.nciprecast.com

Toll Free 800.733.3624
 Phone 419.668.8167
 Fax 419.663.0627

PRECAST CATCH BASINS AND
 INLET BASE SECTIONS

REVISIONS:	DWG. NO.	DATE	SHT. -
	D-0020-03	08-06-03	OF -
			RJS